



Town of Friday Harbor Water, Wastewater, and Solid Waste Utilities Summary Reports

www.fridayharbor.org

Period ending: Sept 2021

Data provided by
Wayne Haefele, PE, Public Works Director
Water Utility, Mike Deegan, Water System Mgr.
Frank Byrne, Water Treatment Plant Operator
Wastewater Utility, Don Reitan, Leadman
Solid Waste Utility, Dave Smith, Leadman

Analysis & Reports prepared by
Mike Greene, System Administrator

Water - use MTD

sourceDate
/
9 / 2021

Spe=Special, Sfr=Single Family Residential, P.A= Public Authority, Mfr=Multi-family, Ind=Industrial, Com=Commerc

Water Class	Accounts	Gallons
Spe	3	53,598
Sfr	1011	4,339,440
PA	82	1,621,249
Mfr	133	2,253,439
Ind	14	303,940
Com	221	2,504,103
TOTAL	1,464	11,075,769

Water use MTD - accounts with sewersourceDate
/
9 / 2021

Sewer Class	Accounts	Gallons
Location: IN		
Mfr In/low Strength	68	738,112
Com In/lo Strength	164	1,440,050
Dot In/lo Strength	3	37,890
Ind In/hi Strength	1	70,760
Ind In/lo Strength	10	219,180
Lmf In/lo Strength	1	3,780
Com In/hi Strength	43	986,971
Mfr In/lo Strength	54	708,744
Mhp In/lo Strength	2	411,400
PA In/hi Strength	3	149,680
PA In/lo Strength	45	719,150
Sfr IN Town	635	2,534,476
Low Rate / IN Town	6	10,950
	<hr/> 1035	<hr/> 8,031,143
Location: Out		
UW Out/hi Strength	1	145,400
Mfr Out/lo Strength	1	14,220
Sfr Out of Town	4	16,004
	<hr/> 6	<hr/> 175,624

Sewer Class	Accounts	Gallons
TOTAL	1041	8,206,767

Water - use MTD by Location

sourceDate
/
9 / 2021

Spe=Special, Sfr=Single Family Residential, P.A= Public Authority, Mfr=Multi-family, Ind=Industrial, Com=Commerc

Water Class	Accounts	Gallons
Location: IN		
Spe	2	52,340
Sfr	658	2,582,133
PA	73	1,407,209
Mfr	128	1,968,099
Ind	13	302,120
Com	218	2,492,663
	1,092	8,804,564
Location: Out		
Spe	1	1,258
Sfr	353	1,757,307
PA	9	214,040
Mfr	5	285,340
Ind	1	1,820
Com	3	11,440
	372	2,271,205
TOTAL	1,464	11,075,769

Refuse - pickups by Class

sourceDate
/
9 / 2021

Location	Class	Pickups
IN	Sfr	2,129.0
	RefuseOnly	339.0
	PA	140.5
	Mfr	576.0
	Ind	19.0
	Com	3,017.0
		6,220.5
Out	Mfr	12.0
		12.0
TOTAL		6,232.5

Refuse - active accounts

sourceDate

/
9 / 2021

Location	Refuse Type	Accounts
IN		
	Small Dumpster	41
	PA	42
	Medium Dumpste	56
	Large Dumpster	69
	Compactors	4
	Cans Low Rate	6
	Cans	880
		<hr/>
		1,098
Out		
	Large Dumpster	1
		<hr/>
		1
		<hr/>
	TOTAL	1,099

Recycle - pickups by Class

sourceDate

/
9 / 2021


Location	Class	Pickups
IN	Sfr	819
	RefuseOnly	30
	PA	0
	Mfr	96
	Ind	0
	Com	0
		945
Out	Mfr	0
		0
TOTAL		945

Town of Friday Harbor

Refuse Pickups - 2021 YTD

Account Type	SFR	Refuse Only	P.A	MFR	IND	COM	Other	Total
Jan	1,990.0	221.0	90.0	613.0	14.0	1,444.0	7.0	4,379.0
Feb	1,912.0	196.0	103.5	548.5	19.5	1,581.0	8.0	4,368.5
Mar	1,696.0	191.0	107.0	531.5	22.5	1,754.5	7.0	4,309.5
Apr	2,038.0	234.5	131.5	571.0	20.8	2,273.5	7.0	5,276.3
May	2,440.0	244.0	121.0	641.5	19.0	2,466.0	9.0	5,940.5
Jun	2,169.0	294.0	114.0	618.0	19.0	2,735.5	10.0	5,959.5
Jul	2,323.0	386.5	85.0	659.0	20.0	3,439.3	14.0	6,926.8
Aug	2,443.0	408.0	89.0	657.0	21.5	3,599.5	11.0	7,229.0
Sep	2,129.0	339.0	140.5	576.0	19.0	3,017.0	12.0	6,232.5
Oct								0.0
Nov								0.0
Dec								0.0
YTD	19,140.0	2,514.0	981.5	5,415.5	175.3	22,310.3	85.0	50,621.6

Refuse Pickups by Month - 2020

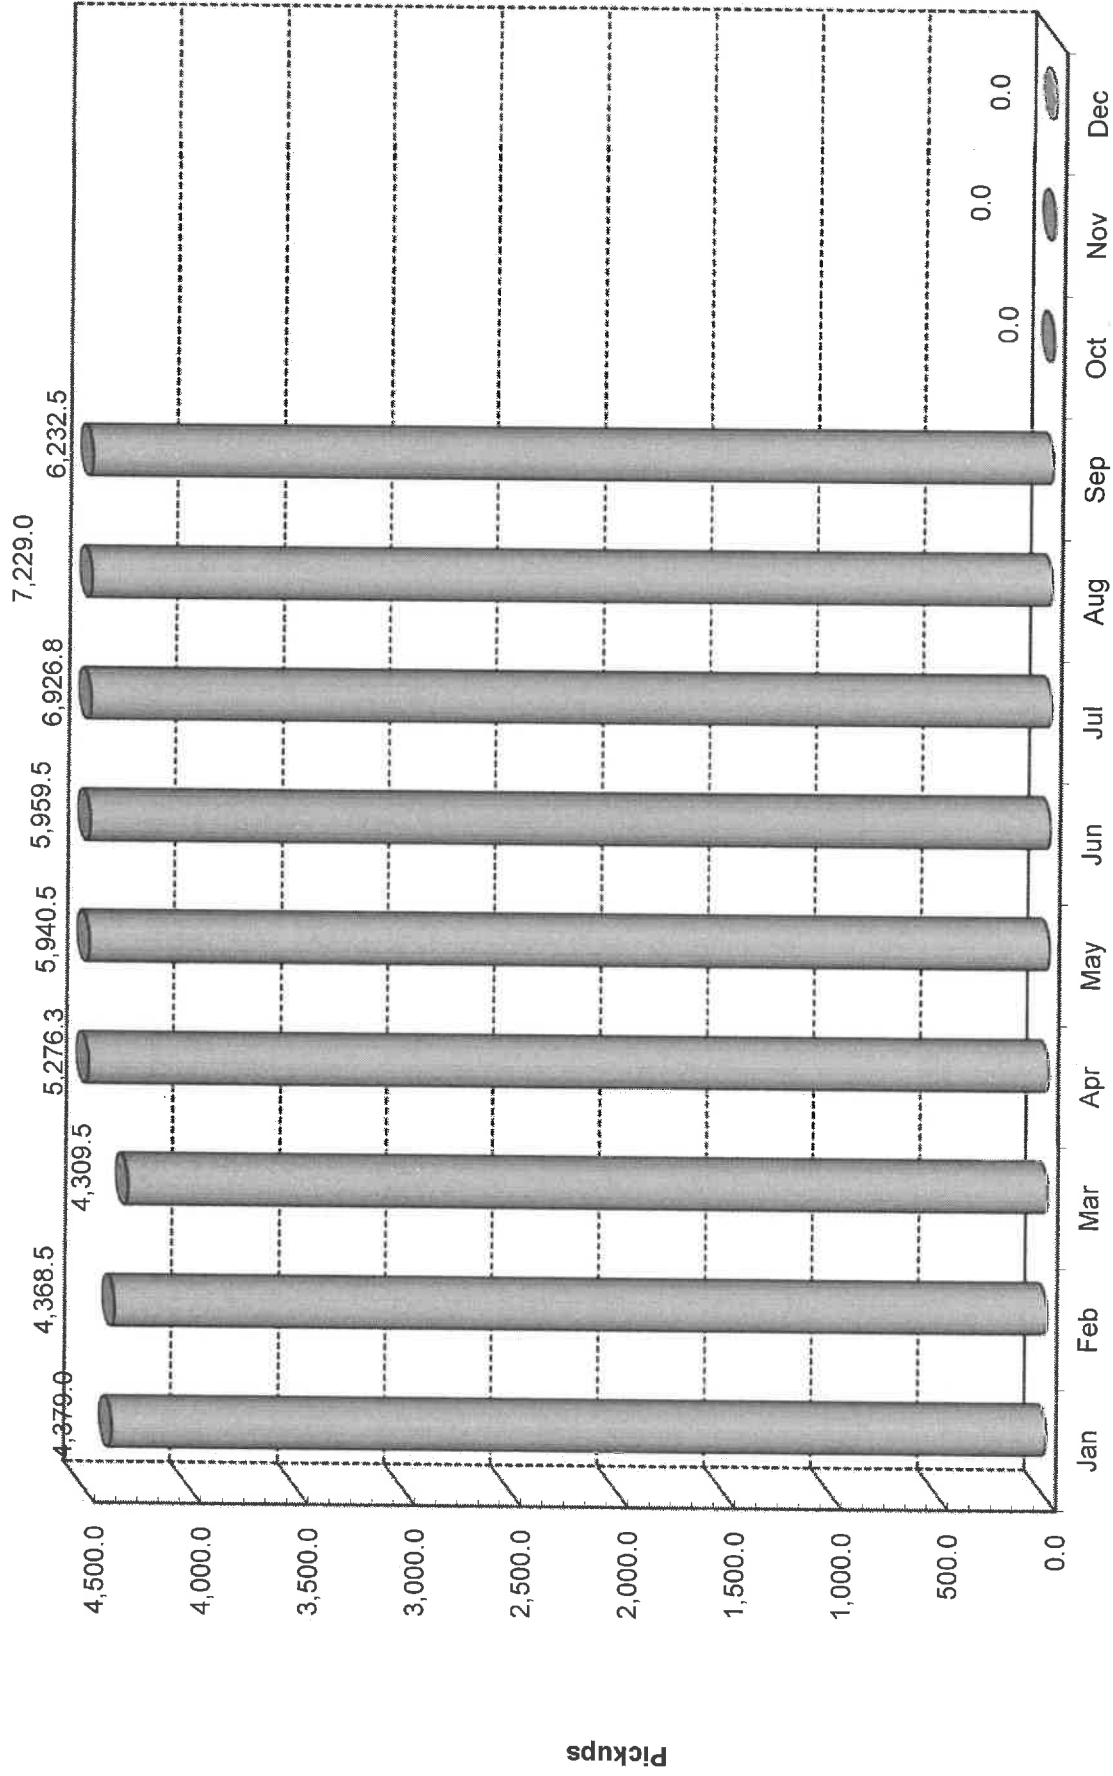

TOWN OF FRIDAY HARBOR

Flow to Town (Gross Water Production) 2020

Revised reporting period: per K. Anderson 03/06/17
to reflect meter reading dates (?).

Reporting (meter reading) period			days in period	Gross flow to Town	Flow to Town (millions)
<i>from WTP Chem. Wts. & Finish Flow to Town Report</i>					
15-Dec	<i>to</i>	14-Jan	31	7,320,000	7,320
15-Jan	<i>to</i>	14-Feb	31	7,539,000	7,539
15-Feb	<i>to</i>	14-Mar	28	7,160,000	7,160
15-Mar	<i>to</i>	14-Apr	31	8,464,000	8,464
15-Apr	<i>to</i>	16-May	32	10,115,000	10,115
17-May	<i>to</i>	14-Jun	29	10,626,000	10,626
15-Jun	<i>to</i>	14-Jul	30	13,725,000	13,725
15-Jul	<i>to</i>	15-Aug	32	14,978,000	14,978
16-Aug	<i>to</i>	14-Sep	30	12,019,000	12,019
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
			274	91,946,000	91946.0

TOWN OF FRIDAY HARBOR

WATER CONSUMPTION (Use) BY CUSTOMER CLASS

source: utilITy08 & 13.mdb

2020		CLASS:										TOTAL % of Use		Avg Daily Use	
		COM	IND	MFR	P.A	SFR	Special	other uses							
JAN	1,245,000	106,800	1,477,460	778,750	2,353,930	8,953	519,909	6,490,802	6.4%	209,381					
FEB	1,472,570	103,550	1,708,290	877,370	2,579,290	31,010	586,762	7,358,842	7.2%	253,753					
MAR	1,269,760	79,450	1,581,430	597,760	2,269,100	15,009	668,075	6,480,584	6.4%	209,051					
APR	855,070	67,640	1,845,470	421,860	2,823,760	41,241	621,772	6,676,813	6.6%	222,560					
MAY	979,450	83,580	1,960,930	673,160	3,435,470	102,507	630,453	7,865,550	7.7%	253,727					
JUN	1,163,080	85,270	2,111,320	827,450	3,654,370	42,123	699,038	8,582,651	8.4%	286,088					
JUL	1,887,081	227,720	2,157,360	1,425,030	4,208,750	64,034	730,076	10,700,054	10.5%	345,163					
AUG	2,827,729	284,390	2,761,360	2,072,320	5,553,590	139,076	800,183	14,438,668	14.2%	465,763					
SEP	2,207,410	222,810	2,194,420	1,543,250	4,211,890	112,212	579,688	11,071,680	10.9%	369,056					
OCT	1,679,380	128,740	2,014,950	1,065,460	2,981,580	41,258	675,971	8,587,339	8.4%	277,011					
NOV	1,265,230	97,420	1,931,840	618,010	2,785,370	30,930	557,304	7,286,104	7.1%	242,870					
DEC	993,490	89,190	1,717,840	424,420	2,518,610	28,300	604,796	6,376,646	6.3%	205,698					
TOTAL	17,845,250	1,576,560	23,462,690	11,324,840	39,375,710	656,653	7,674,030	101,915,733	100.0%	278,458					
AVERAGE	1,487,104	131,380	1,955,224	943,737	3,281,309	54,721	639,503	8,492,978	8.4%	22,371					
% of USE	17.5%	1.5%	23.0%	11.1%	38.6%	0.6%	7.5%	100.0%	106.436,000	100.0%	106.436,000	:FLOW (Use+Loss)	-4.2%	Loss as % of Flow	
% of FLOW	16.8%	1.5%	22.0%	10.6%	37.0%	0.6%	7.2%	95.8%	100.0%	95.8%	100.0%	:LOSS for Year	-4.2%	Loss as % of Flow	

2021		CLASS:										TOTAL % of Use		Avg Daily Use	
		COM	IND	MFR	P.A	SFR	Special	other uses							
JAN	943,778	86,800	1,925,507	421,580	2,857,180	14,797	568,569	6,818,211	7.8%	219,942					
FEB	1,019,552	99,720	2,009,594	424,210	2,683,576	14,773	873,443	7,124,868	8.1%	245,685					
MAR	1,134,550	88,180	1,663,991	379,770	2,288,939	26,197	689,989	6,271,616	7.2%	202,310					
APR	1,530,264	123,740	2,047,854	564,700	2,798,290	22,363	582,066	7,669,307	8.8%	255,644					
MAY	1,764,589	144,350	2,245,302	833,740	3,508,804	36,628	991,837	9,525,250	10.9%	307,266					
JUN	2,087,531	168,720	2,157,495	1,122,340	4,054,951	40,167	662,526	10,293,730	11.7%	343,124					
JUL	2,745,449	219,570	2,503,215	1,917,270	5,527,261	107,125	571,487	13,591,377	15.5%	438,432					
AUG	3,016,623	217,680	2,618,318	2,611,540	5,548,047	124,759	586,459	14,723,426	16.8%	474,949					
SEP	2,504,103	303,940	2,253,439	1,621,249	4,339,440	53,598	554,913	11,630,682	13.3%	387,689					
OCT								0	0.0%	0					
NOV								0	0.0%	0					
DEC								0	0.0%	0					
TOTAL	16,746,439	1,452,700	19,424,715	9,896,399	33,606,488	440,407	6,081,319	87,648,467	100.0%	319,865					
AVERAGE	1,860,715	161,411	2,158,302	1,099,600	3,734,054	48,934	506,777	7,304,039	7.3%	26,651					
% of USE	19.1%	1.7%	22.2%	11.3%	38.3%	0.5%	6.9%	100.0%	91.946,000	100.0%	91.946,000	:FLOW (Use+Loss)	-4.7%	Loss as % of Flow	
% of FLOW	18.2%	1.6%	21.1%	10.8%	36.6%	0.5%	6.6%	95.3%	100.0%	95.3%	100.0%	:LOSS for Year	-4.7%	Loss as % of Flow	

TOWN OF FRIDAY HARBOR

Net Water Production - 2021

amounts in gallons

	Jan	Feb	Mar	Apr	May	Jun
Gross Production for billing period from WTP Chemical Weights & Finish Flow to Town Report	7,320,000	7,539,000	7,160,000	8,464,000	10,115,000	10,626,000
3% meter loss	187,489	187,543	167,449	212,616	256,002	288,936
Flushing	172,750	555,250	405,350	101,100	208,700	116,850
SUC#3 FD use	5,000	5,000	5,000	5,000	30,400	10,000
Leaks	203,330	125,650	112,190	263,380	496,735	246,740
other non-metered use						
Additional water in storage						
notes						
Total other uses	-568,569	-873,443	-689,989	-582,096	-991,837	-662,526
Net production	6,751,431	6,665,557	6,470,011	7,881,904	9,123,163	9,963,474
	Jul	Aug	Sep	Oct	Nov	Dec
Gross Production for billing period from WTP Chemical Weights & Finish Flow to Town Report	13,725,000	14,978,000	12,019,000	0	0	0
3% meter loss	390,597	424,109	332,273	0	0	0
Flushing	42,500	13,350	49,500	0	0	0
SUC#3 FD use	5,000	5,000	5,000	0	0	0
Leaks	133,390	144,000	168,140	0	0	0
other non-metered use						
notes						
Total other uses	-571,487	-586,459	-554,913	0	0	0
Net production	13,153,513	14,391,541	11,464,087	0	0	0

TOWN OF FRIDAY HARBOR

Water Consumption & Production

Revised meter loss reporting begin 07/09 (per Robert Krebs, Evergreen Rural Water Assoc.)

Period	USE (consumption)	Cumulative Use YTD	Flow (production)	Unaccounted over / (under)	Cumulative Flow YTD	Average Daily Flow	
2019							
<i>gallons</i>							
Jan-19	6,193,133		6,982,000	-788,867		225,226	
Feb-19	7,413,239	13,606,372	7,865,000	-451,761	14,847,000	280,893	
Mar-19	6,065,311	19,671,683	7,468,000	-1,402,689	22,315,000	240,903	
Apr-19	7,852,517	27,524,200	8,604,000	-751,483	30,919,000	286,800	
May-19	8,660,158	36,184,358	9,522,000	-861,842	40,441,000	307,161	
Jun-19	12,028,022	48,212,379	12,495,000	-466,978	52,936,000	416,500	
Jul-19	12,121,969	60,334,348	12,159,000	-37,031	65,095,000	392,226	YTD
Aug-19	13,865,988	74,200,336	13,977,000	-111,012	79,072,000	450,871	Unaccounted
Sep-19	12,170,164	86,370,500	12,723,000	-552,836	91,795,000	424,100	as % of Flow
Average	8,415,461	94,785,961	8,868,000	-452,539	100,663,000	286,065	8.25%
Monthly Use	7,281,193	102,067,154	7,708,000	-426,807	108,371,000	256,933	
9,060,242	6,655,754	108,722,907	7,416,000	-760,246	115,787,000	239,226	-9,750,254
YEAR TOTAL:	12	108,722,907	Cumulative	115,787,000	-7,064,093	Cumulative	317,242
		Metered/Other	Use YTD		Unaccounted	3% meter loss	2,989,222
2020							
<i>gallons</i>							
Jan-20	6,490,802		6,771,000	-280,198		218,419	
Feb-20	7,358,842	13,849,644	7,991,000	-632,158	14,762,000	285,393	
Mar-20	6,480,584	20,330,228	7,169,000	-688,416	21,931,000	231,258	
Apr-20	6,676,813	27,007,042	6,984,000	-307,187	28,915,000	232,800	
May-20	7,865,550	34,872,592	7,971,000	-105,450	36,886,000	257,129	
Jun-20	8,582,651	43,455,243	9,137,000	-554,349	46,023,000	304,567	
Jul-20	10,700,054	54,155,297	10,903,000	-202,946	56,926,000	351,710	YTD
Aug-20	14,438,668	68,593,965	14,737,000	-298,332	71,663,000	475,387	Unaccounted
Sep-20	11,071,680	79,665,645	11,463,000	-391,320	83,126,000	382,100	as % of Flow
Average	8,587,339	88,252,984	8,823,000	-235,661	91,949,000	284,613	4.25%
Monthly Use	7,286,104	95,539,088	7,733,000	-446,896	99,682,000	257,767	
8,492,978	6,376,646	101,915,733	6,754,000	-377,355	106,436,000	217,871	-4,520,267
YEAR TOTAL:	12	101,915,733	Cumulative	106,436,000	-4,520,267	Cumulative	291,584
		Metered/Other	Use YTD		Unaccounted	3% meter loss	2,827,251
2021							
<i>gallons</i>							
Jan-21	6,818,211		7,320,000	-501,789		236,129	
Feb-21	7,124,868	13,943,079	7,539,000	-414,132	14,859,000	269,250	
Mar-21	6,271,616	20,214,695	7,160,000	-888,384	22,019,000	230,968	
Apr-21	7,669,307	27,884,002	8,464,000	-794,693	30,483,000	282,133	
May-21	9,525,250	37,409,253	10,115,000	-589,750	40,598,000	326,290	
Jun-21	10,293,730	47,702,983	10,626,000	-332,270	51,224,000	354,200	
Jul-21	13,591,377	61,294,359	13,725,000	-133,623	64,949,000	442,742	YTD
Aug-21	14,723,426	76,017,785	14,978,000	-254,574	79,927,000	483,161	Unaccounted
Sep-21	11,630,682	87,648,467	12,019,000	-388,318	91,946,000	400,633	as % of Flow
Average	0	87,648,467	0	0	91,946,000	0	4.67%
Monthly Use	0	87,648,467	0	0	91,946,000	0	
9,738,719	0	87,648,467	0	0	91,946,000	0	-4,297,533
YEAR TOTAL:	9	87,648,467	Cumulative	91,946,000	-4,297,533	Cumulative	336,167
		Metered/Other	Use YTD		Unaccounted	3% meter loss	2,447,014

3 YEAR AVERAGES: Use 5,950,648 :gal/month Flow 9,520,273 :gal/month Daily Flow 209,251 as % of Flow **5.91%**

source: Monthly Water Treatment Plant Report & utility.mdb's 3 yr cumulative flow 314,169,000 3 yr unaccounted -18,568,053

Utilization of Sustainable Annual Water System Capacity

Period start: Oct-20

Period end: Sep-21

Sustainable Annual Yield (TFH
Comprehensive Water System Plan
Update, June, 2013, page 3-6)

205 million gallons

Annual use - 12 month period
percent of Sustainable Annual Yield

115.3 million gallons
56.2%

Exceeds Sustainable Yield?

No

TOWN OF FRIDAY HARBOR

Trout Lake Reservoir Level

Months with positive levels may reflect that a removable 7.25 inch riser has been added to the top of the original spillway.

<i>end of</i>	<i>Inches above/(below) original spillway</i>	<i>end of</i>	<i>Inches above/(below) original spillway</i>	<i>end of</i>	<i>Inches above/(below) original spillway</i>
Jan-15	0.00	Jan-18	0.00	Jan-21	0.00
Feb-15	0.00	Feb-18	0.00	Feb-21	0.00
Mar-15	0.00	Mar-18	8.75	Mar-21	8.25
Apr-15	6.50	Apr-18	8.25	Apr-21	4.30
May-15	0.00	May-18	1.50	May-21	4.30
Jun-15	-13.00	Jun-18	-10.50	Jun-21	-5.50
Jul-15	-29.50	Jul-18	-29.50	Jul-21	-34.00
Aug-15	-42.25	Aug-18	-42.00	Aug-21	-48.00
Sep-15	-49.50	Sep-18	-50.00	Sep-21	-48.00
Oct-15	-54.50	Oct-18	-54.50	Oct-21	
Nov-15	-17.25	Nov-18	-55.50	Nov-21	
Dec-15	0.00	Dec-18	-26.00	Dec-21	
Jan-16	0.00	Jan-19	0.00	Jan-22	
Feb-16	0.00	Feb-19	0.00	Feb-22	
Mar-16	0.00	Mar-19	2.75	Mar-22	
Apr-16	6.00	Apr-19	2.75	Apr-22	
May-16	-2.50	May-19	-0.75	May-22	
Jun-16	-11.00	Jun-19	-2.00	Jun-22	
Jul-16	-21.00	Jul-19	-16.00	Jul-22	
Aug-16	-36.50	Aug-19	-26.25	Aug-22	
Sep-16	-49.50	Sep-19	-40.00	Sep-22	
Oct-16	-51.00	Oct-19	-46.25	Oct-22	
Nov-16	-45.50	Nov-19	-49.75	Nov-22	
Dec-16	-10.35	Dec-19	-49.50	Dec-22	
Jan-17	0.00	Jan-20	-11.00	Jan-23	
Feb-17	0.00	Feb-20	0.00	Feb-23	
Mar-17	2.75	Mar-20	0.00	Mar-23	
Apr-17	9.00	Apr-20	4.00	Apr-23	
May-17	4.75	May-20	0.00	May-23	
Jun-17	-4.00	Jun-20	-0.75	Jun-23	
Jul-17	-19.00	Jul-20	-8.50	Jul-23	
Aug-17	-32.00	Aug-20	-22.50	Aug-23	
Sep-17	-43.00	Sep-20	-34.00	Sep-23	
Oct-17	-50.50	Oct-20	-42.50	Oct-23	
Nov-17	-48.00	Nov-20	-45.25	Nov-23	
Dec-17	-11.50	Dec-20	-28.25	Dec-23	

Rainfall - Trout Lake Water Treatment Facility

source: Water Treatment Plant Weather Reports

all figures in inches

	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	average (2005-14)
JAN	5.49	6.87	6.51	2.34	3.82	4.73	5.90	3.46	4.14	2.86	4.61
FEB	1.01	1.61	2.83	1.78	1.50	1.24	2.74	3.38	1.32	4.22	2.16
MAR	2.33	0.91	3.70	1.99	2.05	3.30	3.37	3.09	3.63	3.88	2.83
APR	1.37	2.23	1.49	1.32	2.07	1.47	2.96	1.91	2.70	1.94	1.95
MAY	1.08	1.24	0.78	1.26	1.69	2.09	3.07	1.09	2.20	1.05	1.56
JUN	1.63	0.56	1.03	1.16	0.35	1.10	0.68	2.60	0.83	0.52	1.05
JUL	0.70	0.26	1.56	0.21	0.45	0.11	0.84	1.04	0.00	0.36	0.55
AUG	1.60	0.03	0.64	1.88	0.81	0.72	0.29	0.00	0.95	0.49	0.74
SEP	0.94	1.15	0.54	0.84	1.58	4.35	0.72	0.12	5.08	1.34	1.67
OCT	3.50	1.89	2.12	1.83	5.24	1.38	2.29	6.40	1.42	4.00	3.01
NOV	4.28	10.43	2.32	5.15	6.76	2.94	4.50	3.32	2.49	4.00	4.62
DEC	2.89	3.74	4.59	3.70	1.80	6.55	1.88	4.79	2.28	3.37	3.56
Total	26.82	30.92	28.11	23.46	28.12	29.98	29.24	31.20	27.04	28.03	28.29

Cumulative thru

DEC	26.82	30.92	28.11	23.46	28.12	29.98	29.24	31.20	27.04	28.03
-----	-------	-------	-------	-------	-------	-------	-------	-------	-------	-------

all figures in inches

	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
JAN	3.97	2.17	1.60	5.10	3.87	7.32	4.36			
FEB	2.95	4.83	2.99	3.80	1.76	5.34	3.41			
MAR	3.62	2.88	3.27	1.48	0.87	1.25	1.18			
APR	0.51	0.75	2.20	3.10	1.61	1.38	1.12			
MAY	0.30	0.48	1.61	0.07	1.29	1.49	0.40			
JUN	0.14	1.22	0.75	0.72	0.61	1.25	0.69			
JUL	0.36	0.32	0.15	0.18	0.75	0.86	0.00			
AUG	0.94	0.11	0.11	0.01	0.84	0.68	0.30			
SEP	1.28	1.40	0.71	1.27	2.74	2.34	3.76			
OCT	3.53	4.80	4.28	2.23	3.33	3.39				
NOV	6.19	3.47	4.32	4.32	2.1	4.68				
DEC	5.26	4.02	3.83	4.26	3.63	6.81				
Total	29.05	26.45	25.82	26.54	23.40	36.79	15.22	0.00	0.00	0.00

Cumulative thru

DEC	29.05	26.45	25.82	26.54	23.40	36.79	15.22	0.00	0.00	0.00
-----	-------	-------	-------	-------	-------	-------	-------	------	------	------

Prevention of Wastewater Facility Overloading

Period start: Jan-20
 Period end: Dec-20

INFLUENT BOD LOADING (pounds per day)		AVG. EFFLUENT FLOW (millions of gallons per day)		SUSPENDED SOLIDS LOADING (pounds per day)	
Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max:month	1,600	Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max:month	0.69000	Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max:month	1,110
85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1)	1,360	85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1)	0.58650	85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1)	944
Month with highest average loading in period	Jan-19	Month with highest average flow in period	Jan-19	Month with highest average loading in period	Jan-19
Highest average monthly loading in period (pounds per day)	559	Highest average monthly flow in period (millions of gallons per day)	0.4088414	Highest average monthly loading in period (pounds per day)	488
% of Design Criteria	35%	% of Design Criteria	59%	% of Design Criteria	44%
exceeds Design Criteria?	No	exceeds Design Criteria?	No	exceeds Design Criteria?	No
Previous month's loading	509	Previous month's flow	0.2541	Previous month's loading	319
Following month's loading	524	Following month's flow	0.2799	Following month's loading	245
exceeds Planning Threshold for 3 consecutive months?	No	exceeds Planning Threshold for 3 consecutive months?	No	exceeds Planning Threshold for 3 consecutive months?	No