



# Town of Friday Harbor Water, Wastewater, and Solid Waste Utilities Summary Reports

[www.fridayharbor.org](http://www.fridayharbor.org)

**Period ending: Jan 2022**

Data provided by  
Wayne Haefele, PE, Public Works Director  
Water Utility, Mike Deegan, Water System Mgr.  
Frank Byrne, Water Treatment Plant Operator  
Wastewater Utility, Don Reitan, Leadman  
Solid Waste Utility, Dave Smith, Leadman

Analysis & Reports prepared by  
Mike Greene, System Administrator

---

**Water - use MTD**

sourceDate

/

1 / 2022

Spe=Special, Sfr=Single Family Residential, P.A= Public Authority, Mfr=Multi-family, Ind=Industrial, Com=Commerc

---

<b>Water Class</b>	<b>Accounts</b>	<b>Gallons</b>
Spe	2	6,043
Sfr	1015	2,869,118
PA	82	390,738
Mfr	132	1,859,134
Ind	14	106,940
Com	221	1,349,356
<b>TOTAL</b>	<b>1,466</b>	<b>6,581,329</b>

---

---

**Water use MTD - accounts with sewer**

sourceDate

/

1 / 2022

---

Sewer Class	Accounts	Gallons
<b>Location: IN</b>		
Mfr In/low Strength	59	687,732
Com In/lo Strength	165	762,584
Dot In/lo Strength	3	53,210
Ind In/hi Strength	1	37,760
Ind In/lo Strength	10	60,630
Lmf In/lo Strength	1	4,700
Com In/hi Strength	42	561,119
Mfr In/lo Strength	62	678,766
Mhp In/lo Strength	2	309,200
PA In/hi Strength	3	51,810
PA In/lo Strength	46	169,738
Sfr IN Town	637	1,781,396
Low Rate / IN Town	6	8,630
	1037	5,167,275

**Location: Out**

UW Out/hi Strength	1	49,400
Mfr Out/lo Strength	1	14,070
Sfr Out of Town	4	30,815
	6	94,285

---

<b>Sewer Class</b>	<b>Accounts</b>	<b>Gallons</b>
<b>TOTAL</b>	<b>1043</b>	<b>5,261,560</b>

---

# Water - use MTD by Location

sourceDate  
/  
1 / 2022

Spe=Special, Sfr=Single Family Residential, P.A= Public Authority, Mfr=Multi-family, Ind=Industrial, Com=Commerc

Water Class	Accounts	Gallons
<b>Location: IN</b>		
Spe	2	6,043
Sfr	659	1,810,126
PA	73	318,198
Mfr	127	1,766,444
Ind	13	104,420
Com	218	1,338,793
	1,092	5,344,024
<b>Location: Out</b>		
Sfr	356	1,058,992
PA	9	72,540
Mfr	5	92,690
Ind	1	2,520
Com	3	10,563
	374	1,237,305
<b>TOTAL</b>	<b>1,466</b>	<b>6,581,329</b>

# Refuse - pickups by Class

sourceDate

/  
1 / 2022

Location	Class	Pickups
IN	Sfr	2,031.0
	RefuseOnly	264.5
	PA	107.0
	Mfr	566.0
	Ind	17.5
	Com	1,639.0
		4,625.0
Out	Mfr	5.0
		5.0
<b>TOTAL</b>		<b>4,630.0</b>

**Refuse - active accounts**

sourceDate  
/  
1 / 2022

Location	Refuse Type	Accounts
IN		
	Small Dumpster	42
	PA	41
	Medium Dumpste	54
	Large Dumpster	71
	Compactors	4
	Cans Low Rate	6
	Cans	883
		<hr/> 1,101
Out		
	Large Dumpster	1
		<hr/> 1
	<b>TOTAL</b>	<b>1,102</b>

**Recycle - pickups by Class**

sourceDate  
/  
1 / 2022


Location	Class	Pickups
IN	Sfr	927
	RefuseOnly	41
	PA	0
	Mfr	97
	Ind	2
	Com	4
		<hr/> 1,071
Out	Mfr	0
		<hr/> 0
<b>TOTAL</b>		<b>1,071</b>



## Refuse Pickups - 2022 YTD

Account Type	SFR	Refuse Only	P.A	MFR	IND	COM	Other	Total
Jan	2,031.0	264.5	107.0	566.0	17.5	1,639.0	5.0	4,630.0
Feb								0.0
Mar								0.0
Apr								0.0
May								0.0
Jun								0.0
Jul								0.0
Aug								0.0
Sep								0.0
Oct								0.0
Nov								0.0
Dec								0.0
YTD	2,031.0	264.5	107.0	566.0	17.5	1,639.0	5.0	4,630.0

# Refuse Pickups by Month - 2022

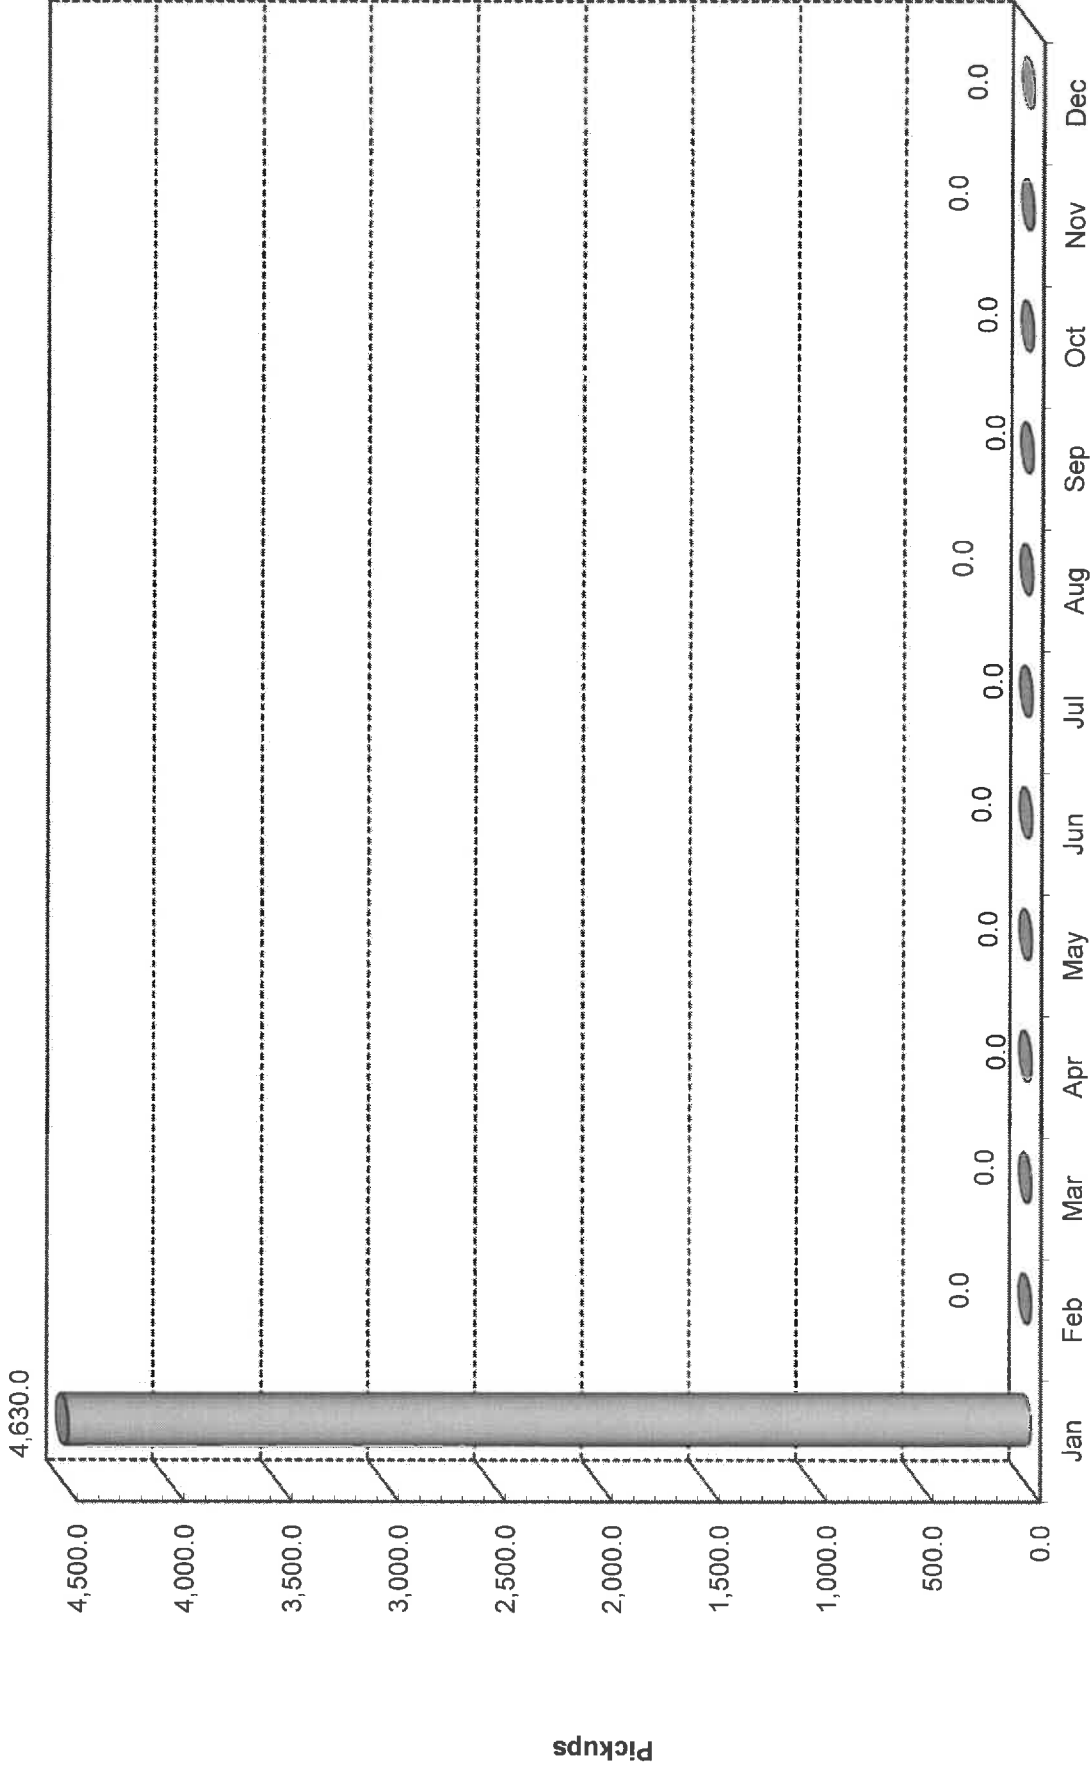

**Finish Water Flow to Town**  
source: Water Treatment Facility Monthly Report

Revised reporting period: per K. Anderson 03/06/17  
to reflect meter reading dates (?).  
Start/End dates may change monthly.

30 :count of days in reporting period.

	December 15, 2021		January 13, 2022
day	flow (total flow)	day	flow (total flow)
13		1	275
14		2	251
15	219	3	275
16	212	4	283
17	218	5	279
18	238	6	278
19	198	7	279
20	204	8	292
21	244	9	281
22	284	10	277
23	220	11	286
24	198	12	262
25	239	13	245
26	188	14	
27	222	15	
28	259	16	
29	273		
30	237		
31	275		
days	17	3928	
		TOTAL DAYS	
		TOTAL FLOW	
			7491
			1,000's gallons

TOWN OF FRIDAY HARBOR

## Flow to Town (Gross Water Production) 2022

Revised reporting period: per K. Anderson 03/06/17  
 to reflect meter reading dates (?).

Reporting (meter reading) period			days in period	Gross flow to Town	Flow to Town (millions)
<i>from WTP Chem. Wts. &amp; Finish Flow to Town Report</i>	<i>to</i>				
15-Dec	<i>to</i>	13-Jan	30	7,491,000	7,491
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
	<i>to</i>		0	0	
			30	7,491,000	7491.0

## Net Water Production - 2022

amounts in gallons

	Jan	Feb	Mar	Apr	May	Jun
Gross Production for billing period from WTP Chemical Weights & Finish Flow to Town Report	7,491,000	0	0	0	0	0
3% meter loss	197,440	0	0	0	0	0
Flushing	143,850					
SJC#3 FD use	5,000					
Leaks	100,000					
notes						
other non-metered use						
notes						
Additional water in storage						
notes						
Total other uses	-446,290					
<b>Net production</b>	<b>7,044,710</b>					

	Jul	Aug	Sep	Oct	Nov	Dec
Gross Production for billing period from WTP Chemical Weights & Finish Flow to Town Report	0	0	0	0	0	0
3% meter loss	0	0	0	0	0	0
Flushing						
SJC#3 FD use						
Leaks						
notes						
other non-metered use						
notes						
Total other uses	0	0	0	0	0	0
<b>Net production</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

### WATER CONSUMPTION (Use) BY CUSTOMER CLASS

source: utilrty08 & 13.mdb

2021

CLASS:	COM	IND	MFR	P.A	SFR	Special	other uses	TOTAL	% of Use	Avg. Daily Use
JAN	1,245,000	106,800	1,477,460	778,750	2,353,930	8,953	519,909	6,490,802	6.4%	209,381
FEB	1,472,570	103,550	1,708,290	877,370	2,579,290	31,010	586,762	7,358,842	7.2%	253,753
MAR	1,269,760	79,450	1,581,430	597,760	2,269,100	15,009	668,075	6,480,584	6.4%	209,051
APR	855,070	67,640	1,845,470	421,860	2,823,760	41,241	621,772	6,676,813	6.6%	222,560
MAY	979,450	83,580	1,960,930	673,160	3,435,470	102,507	630,453	7,865,550	7.7%	253,727
JUN	1,163,080	85,270	2,111,320	827,450	3,654,370	42,123	699,038	8,582,651	8.4%	286,088
JUL	1,887,081	227,720	2,157,360	1,425,030	4,208,750	64,034	730,079	10,700,054	10.5%	345,163
AUG	2,827,729	284,390	2,761,380	2,072,320	5,553,590	139,076	800,183	14,438,668	14.2%	465,763
SEP	2,207,410	222,810	2,194,420	1,543,250	4,211,890	112,212	579,688	11,071,680	10.9%	369,056
OCT	1,679,380	128,740	2,014,950	1,065,460	2,981,580	41,258	675,971	8,587,339	8.4%	277,011
NOV	1,265,230	97,420	1,931,840	618,010	2,785,370	30,930	557,304	7,286,104	7.1%	242,870
DEC	993,490	89,190	1,717,840	424,420	2,518,610	28,300	604,796	6,376,646	6.3%	205,698
<b>TOTAL</b>	<b>17,845,250</b>	<b>1,576,560</b>	<b>23,462,690</b>	<b>11,324,840</b>	<b>39,375,710</b>	<b>656,653</b>	<b>7,674,030</b>	<b>101,915,733</b>	<b>100.0%</b>	<b>278,458</b>
<b>AVERAGE</b>	<b>1,487,104</b>	<b>131,380</b>	<b>1,955,224</b>	<b>943,737</b>	<b>3,281,309</b>	<b>54,721</b>	<b>639,503</b>	<b>8,492,978</b>	<b>-4,520,267</b>	<b>:LOSS for Year</b>
% of USE	17.5%	1.5%	23.0%	11.1%	38.6%	0.6%	7.5%	100.0%	106.436,000	:FLOW (Use+Loss)
% of FLOW	16.8%	1.5%	22.0%	10.6%	37.0%	0.6%	7.2%	95.8%	-4.2%	Loss as % of Flow

2022

CLASS:	COM	IND	MFR	P.A	SFR	Special	other uses	TOTAL	% of Use	Avg. Daily Use
JAN	1,349,356	106,940	1,859,134	390,738	2,869,118	6,043	446,290	7,027,619	100.0%	226,697
FEB								0	0.0%	0
MAR								0	0.0%	0
APR								0	0.0%	0
MAY								0	0.0%	0
JUN								0	0.0%	0
JUL								0	0.0%	0
AUG								0	0.0%	0
SEP								0	0.0%	0
OCT								0	0.0%	0
NOV								0	0.0%	0
DEC								0	0.0%	0
<b>TOTAL</b>	<b>1,349,356</b>	<b>106,940</b>	<b>1,859,134</b>	<b>390,738</b>	<b>2,869,118</b>	<b>6,043</b>	<b>446,290</b>	<b>7,027,619</b>	<b>100.0%</b>	<b>226,697</b>
<b>AVERAGE</b>	<b>1,349,356</b>	<b>106,940</b>	<b>1,859,134</b>	<b>390,738</b>	<b>2,869,118</b>	<b>6,043</b>	<b>37,191</b>	<b>585,635</b>	<b>-463,381</b>	<b>:LOSS for Year</b>
% of USE	19.2%	1.5%	26.5%	5.6%	40.8%	0.1%	6.4%	100.0%	7,491,000	:FLOW (Use+Loss)
% of FLOW	18.0%	1.4%	24.8%	5.2%	38.3%	0.1%	6.0%	93.8%	-6.2%	Loss as % of Flow

TOWN OF FRIDAY HARBOR

# Water Consumption & Production

Revised meter loss reporting begin 07/09 (per Robert Krebs, Evergreen Rural Water Assoc.)

Period	USE (consumption)	Cumulative Use YTD	Flow (production)	Unaccounted over / (under)	Cumulative Flow YTD	Average Daily Flow	
<b>2020</b>							
<i>gallons</i>	Jan-20	6,490,802	6,771,000	-280,198		218,419	
	Feb-20	7,358,842	13,849,644	-632,158	14,762,000	285,393	
	Mar-20	6,480,584	20,330,228	-688,416	21,931,000	231,258	
	Apr-20	6,676,813	27,007,042	-307,187	28,915,000	232,800	
	May-20	7,865,550	34,872,592	-105,450	36,886,000	257,129	
	Jun-20	8,582,651	43,455,243	-554,349	46,023,000	304,567	
	Jul-20	10,700,054	54,155,297	-202,946	56,926,000	351,710	YTD
	Aug-20	14,438,668	68,593,965	-298,332	71,663,000	475,387	Unaccounted
	Sep-20	11,071,680	79,665,645	-391,320	83,126,000	382,100	as % of Flow
Average	Oct-20	8,587,339	88,252,984	-235,661	91,949,000	284,613	4.25%
Monthly Use	Nov-20	7,286,104	95,539,088	-446,896	99,682,000	257,767	
8,492,978	Dec-20	6,376,646	101,915,733	-377,355	106,436,000	217,871	-4,520,267
<b>YEAR TOTAL:</b>	12	108,722,907	Cumulative Metered/Other Use YTD	115,787,000	-7,064,093	Cumulative 3% meter loss	317,242 2,989,222
<b>2021</b>							
<i>gallons</i>	Jan-21	6,818,211	7,320,000	-501,789		236,129	
	Feb-21	7,124,868	13,943,079	-414,132	14,859,000	269,250	
	Mar-21	6,271,616	20,214,695	-888,384	22,019,000	230,968	
	Apr-21	7,669,307	27,884,002	-794,693	30,483,000	282,133	
	May-21	9,525,250	37,409,253	-589,750	40,598,000	326,290	
	Jun-21	10,293,730	47,702,983	-332,270	51,224,000	354,200	
	Jul-21	13,591,377	61,294,359	-133,623	64,949,000	442,742	YTD
	Aug-21	14,723,426	76,017,785	-254,574	79,927,000	483,161	Unaccounted
	Sep-21	11,630,682	87,648,467	-388,318	91,946,000	400,633	as % of Flow
Average	Oct-21	8,004,636	95,653,104	-497,364	100,448,000	274,258	5.11%
Monthly Use	Nov-21	7,027,754	102,680,858	-552,246	108,028,000	252,667	
9,093,646	Dec-21	6,442,893	109,123,751	-532,107	115,003,000	225,000	-5,879,249
<b>YEAR TOTAL:</b>	12	109,123,751	Cumulative Metered/Other Use YTD	115,003,000	-5,879,249	Cumulative 3% meter loss	314,786 2,827,251
<b>2022</b>							
<i>gallons</i>	Jan-22	7,027,619	7,491,000	-463,381		241,645	
	Feb-22	0	7,027,619	0	7,491,000	0	
	Mar-22	0	7,027,619	0	7,491,000	0	
	Apr-22	0	7,027,619	0	7,491,000	0	
	May-22	0	7,027,619	0	7,491,000	0	
	Jun-22	0	7,027,619	0	7,491,000	0	
	Jul-22	0	7,027,619	0	7,491,000	0	YTD
	Aug-22	0	7,027,619	0	7,491,000	0	Unaccounted
	Sep-22	0	7,027,619	0	7,491,000	0	as % of Flow
Average	Oct-22	0	7,027,619	0	7,491,000	0	6.19%
Monthly Use	Nov-22	0	7,027,619	0	7,491,000	0	
7,027,619	Dec-22	0	7,027,619	0	7,491,000	0	-463,381
<b>YEAR TOTAL:</b>	1	7,027,619	Cumulative Metered/Other Use YTD	7,491,000	-463,381	Cumulative 3% meter loss	241,645 197,440

3 YEAR AVERAGES:	Use 4,630,021 :gal/month	Flow 9,531,240 :gal/month	Daily Flow 185,477	3 Year Loss as % of Flow 4.75%
---------------------	-----------------------------	------------------------------	-----------------------	--------------------------------------

source: Monthly Water Treatment Plant Report & utility.mdb's  
 3 yr cumulative flow 228,930,000  
 3 yr unaccounted -10,862,897

# Utilization of Sustainable Annual Water System Capacity

Period start: Feb-21

Period end: Jan-22

Sustainable Annual Yield (TFH  
Comprehensive Water System Plan  
Update, June, 2013, page 3-6)

205 million gallons

Annual use - 12 month period  
percent of Sustainable Annual Yield

122.5 million gallons  
59.8%

Exceeds Sustainable Yield?

**No**



TOWN OF FRIDAY HARBOR

**Trout Lake Reservoir Level**

*Months with positive levels may reflect that a removable 7.25 inch riser has been added to the top of the original spillway.*

<i>end of</i>	<i>Inches above/(below) original spillway</i>	<i>end of</i>	<i>Inches above/(below) original spillway</i>	<i>end of</i>	<i>Inches above/(below) original spillway</i>
Jan-15	0.00	Jan-18	0.00	Jan-21	0.00
Feb-15	0.00	Feb-18	0.00	Feb-21	0.00
Mar-15	0.00	Mar-18	8.75	Mar-21	8.25
Apr-15	6.50	Apr-18	8.25	Apr-21	4.30
May-15	0.00	May-18	1.50	May-21	4.30
Jun-15	-13.00	Jun-18	-10.50	Jun-21	-5.50
Jul-15	-29.50	Jul-18	-29.50	Jul-21	-34.00
Aug-15	-42.25	Aug-18	-42.00	Aug-21	-48.00
Sep-15	-49.50	Sep-18	-50.00	Sep-21	-48.00
Oct-15	-54.50	Oct-18	-54.50	Oct-21	-54.50
Nov-15	-17.25	Nov-18	-55.50	Nov-21	-55.00
Dec-15	0.00	Dec-18	-26.00	Dec-21	3.00
Jan-16	0.00	Jan-19	0.00	Jan-22	8.00
Feb-16	0.00	Feb-19	0.00	Feb-22	
Mar-16	0.00	Mar-19	2.75	Mar-22	
Apr-16	6.00	Apr-19	2.75	Apr-22	
May-16	-2.50	May-19	-0.75	May-22	
Jun-16	-11.00	Jun-19	-2.00	Jun-22	
Jul-16	-21.00	Jul-19	-16.00	Jul-22	
Aug-16	-36.50	Aug-19	-26.25	Aug-22	
Sep-16	-49.50	Sep-19	-40.00	Sep-22	
Oct-16	-51.00	Oct-19	-46.25	Oct-22	
Nov-16	-45.50	Nov-19	-49.75	Nov-22	
Dec-16	-10.35	Dec-19	-49.50	Dec-22	
Jan-17	0.00	Jan-20	-11.00	Jan-23	
Feb-17	0.00	Feb-20	0.00	Feb-23	
Mar-17	2.75	Mar-20	0.00	Mar-23	
Apr-17	9.00	Apr-20	4.00	Apr-23	
May-17	4.75	May-20	0.00	May-23	
Jun-17	-4.00	Jun-20	-0.75	Jun-23	
Jul-17	-19.00	Jul-20	-8.50	Jul-23	
Aug-17	-32.00	Aug-20	-22.50	Aug-23	
Sep-17	-43.00	Sep-20	-34.00	Sep-23	
Oct-17	-50.50	Oct-20	-42.50	Oct-23	
Nov-17	-48.00	Nov-20	-45.25	Nov-23	
Dec-17	-11.50	Dec-20	-28.25	Dec-23	

# Rainfall - Trout Lake Water Treatment Facility

source: Water Treatment Plant Weather Reports

*all figures in inches*

	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	average (2005-14)
JAN	5.49	6.87	6.51	2.34	3.82	4.73	5.90	3.46	4.14	2.86	4.61
FEB	1.01	1.61	2.83	1.78	1.50	1.24	2.74	3.38	1.32	4.22	2.16
MAR	2.33	0.91	3.70	1.99	2.05	3.30	3.37	3.09	3.63	3.88	2.83
APR	1.37	2.23	1.49	1.32	2.07	1.47	2.96	1.91	2.70	1.94	1.95
MAY	1.08	1.24	0.78	1.26	1.69	2.09	3.07	1.09	2.20	1.05	1.56
JUN	1.63	0.56	1.03	1.16	0.35	1.10	0.68	2.60	0.83	0.52	1.05
JUL	0.70	0.26	1.56	0.21	0.45	0.11	0.84	1.04	0.00	0.36	0.55
AUG	1.60	0.03	0.64	1.88	0.81	0.72	0.29	0.00	0.95	0.49	0.74
SEP	0.94	1.15	0.54	0.84	1.58	4.35	0.72	0.12	5.08	1.34	1.67
OCT	3.50	1.89	2.12	1.83	5.24	1.38	2.29	6.40	1.42	4.00	3.01
NOV	4.28	10.43	2.32	5.15	6.76	2.94	4.50	3.32	2.49	4.00	4.62
DEC	2.89	3.74	4.59	3.70	1.80	6.55	1.88	4.79	2.28	3.37	3.56
<b>Total</b>	<b>26.82</b>	<b>30.92</b>	<b>28.11</b>	<b>23.46</b>	<b>28.12</b>	<b>29.98</b>	<b>29.24</b>	<b>31.20</b>	<b>27.04</b>	<b>28.03</b>	<b>28.29</b>

Cumulative thru

<b>DEC</b>	<b>26.82</b>	<b>30.92</b>	<b>28.11</b>	<b>23.46</b>	<b>28.12</b>	<b>29.98</b>	<b>29.24</b>	<b>31.20</b>	<b>27.04</b>	<b>28.03</b>
------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------

*all figures in inches*

	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
JAN	3.97	2.17	1.60	5.10	3.87	7.32	4.36	4.49		
FEB	2.95	4.83	2.99	3.80	1.76	5.34	3.41			
MAR	3.62	2.88	3.27	1.48	0.87	1.25	1.18			
APR	0.51	0.75	2.20	3.10	1.61	1.38	1.12			
MAY	0.30	0.48	1.61	0.07	1.29	1.49	0.40			
JUN	0.14	1.22	0.75	0.72	0.61	1.25	0.69			
JUL	0.36	0.32	0.15	0.18	0.75	0.86	0.00			
AUG	0.94	0.11	0.11	0.01	0.84	0.68	0.30			
SEP	1.28	1.40	0.71	1.27	2.74	2.34	3.76			
OCT	3.53	4.80	4.28	2.23	3.33	3.39	4.34			
NOV	6.19	3.47	4.32	4.32	2.1	4.68	11.31			
DEC	5.26	4.02	3.83	4.26	3.63	6.81	4.59			
<b>Total</b>	<b>29.05</b>	<b>26.45</b>	<b>25.82</b>	<b>26.54</b>	<b>23.40</b>	<b>36.79</b>	<b>35.46</b>	<b>4.49</b>	<b>0.00</b>	<b>0.00</b>

Cumulative thru

<b>DEC</b>	<b>29.05</b>	<b>26.45</b>	<b>25.82</b>	<b>26.54</b>	<b>23.40</b>	<b>36.79</b>	<b>35.46</b>	<b>4.49</b>	<b>0.00</b>	<b>0.00</b>
------------	--------------	--------------	--------------	--------------	--------------	--------------	--------------	-------------	-------------	-------------

# Prevention of Wastewater Facility Overloading

Period start: Jan-20  
 Period end: Dec-20

INFLUENT BOD LOADING (pounds per day)	AVG. EFFLUENT FLOW (millions of gallons per day)	SUSPENDED SOLIDS LOADING (pounds per day)
Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max.month 1,600	Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max.month 0.69000	Design Criteria (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.A) max.month 1,110
85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1) 1,360	85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1) 0.58650	85% Capacity Planning Threshold (06/06 NPDES Permit #WA-002358-2, pg 12, paragraph S4.B.1) 944
Month with highest average loading in period Jan-19	Month with highest average flow in period Jan-19	Month with highest average loading in period Jan-19
Highest average monthly loading in period (pounds per day) 559	Highest average monthly flow in period (millions of gallons per day) 0.4088414	Highest average monthly loading in period (pounds per day) 488
% of Design Criteria <b>35%</b>	% of Design Criteria <b>59%</b>	% of Design Criteria <b>44%</b>
exceeds Design Criteria? <b>No</b>	exceeds Design Criteria? <b>No</b>	exceeds Design Criteria? <b>No</b>
Previous month's loading 509	Previous month's flow 0.2541	Previous month's loading 319
Following month's loading 524	Following month's flow 0.2799	Following month's loading 245
exceeds Planning Threshold for 3 consecutive months? <b>No</b>	exceeds Planning Threshold for 3 consecutive months? <b>No</b>	exceeds Planning Threshold for 3 consecutive months? <b>No</b>