

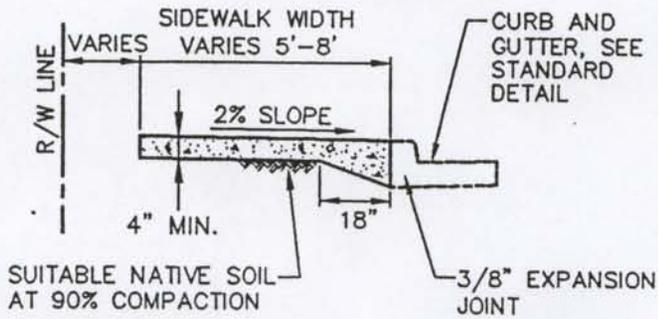


SECTION AT INTERSECTION

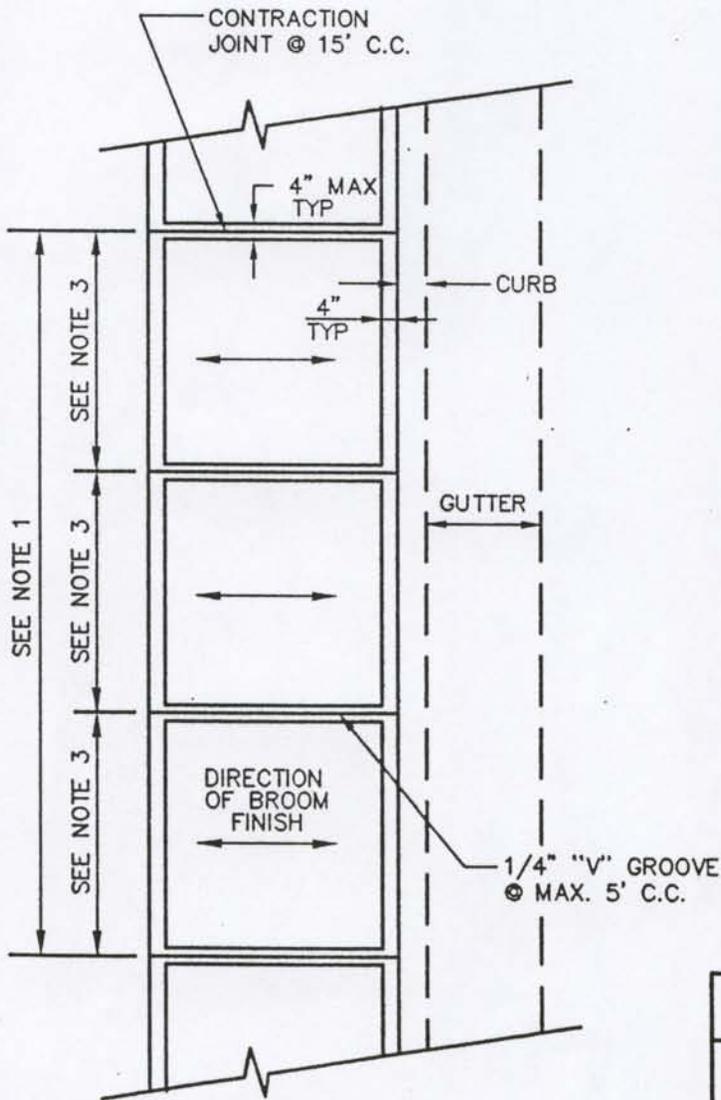

TYPICAL SECTION

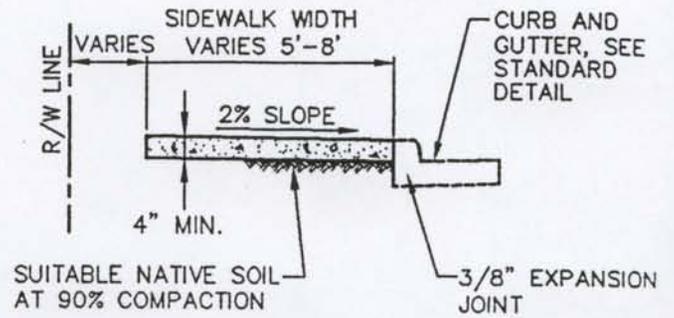

NOTES:

1. CONTRACTION JOINTS SHALL BE 3/8" x 1 1/2" ASPHALT SATURATED FELT PLACED AT 15' ON CENTER (O.C.).
2. THRU JOINTS SHALL BE 3/8" x 4" ASPHALT SATURATED FELT PLACED AT DRIVEWAYS, ALLEY RETURNS AND WHEELCHAIR RAMPS.
3. "V" GROOVE MARKS SHALL BE 1/8" DEEP, AND 1/4" WDE PLACED AT 5' O.C. FOR 5' SIDEWALKS AND 7.5' O.C. FOR 8' SIDEWALKS.
4. ALL JOINTS SHALL BE CLEAN AND EDGED WITH AN EDGE HAVING 1/4" RADIUS. JOINTS SHALL BE FLUSH WITH THE FINISHED SURFACE.
5. ALL UTILITY POLES, STREET SIGN POSTS, METER BOXES, ETC. IN SIDEWALK AREAS SHALL BE SURROUNDED BY 3/8" EXPANSION JOINT MATERIAL AROUND THE STRUCTURE.
6. FORMS SHALL BE EITHER WOOD OR STEEL AND SHALL MEET ALL REQUIREMENTS OF THESE SPECIFICATIONS.
7. CONCRETE SHALL BE CLASS 3000.
8. FOR MINIMUM SIDEWALK WIDTH, SEE TABLE 4B-1

PLAN SIDEWALK WITHOUT PLANTING STRIP

TOWN OF FRIDAY HARBOR

SIDEWALK WITHOUT PLANTING STRIP

APPROVED:

C. King 4/24/00
TOWN ADMINISTRATOR DATE

DWG. NO.

4-12

DATE:

4/20/00

DRWN:

M.S.

CHKD:

T.N.

SCALE:

NO SCALE