



FLOW TO SECOND DISPOSAL TRENCH OR OTHER BRANCHING CB'S AS NECESSARY (TYP.)

INFLUENT PIPE (MAX. DESIGN FLOW < 0.5 CFS PER TRENCH)

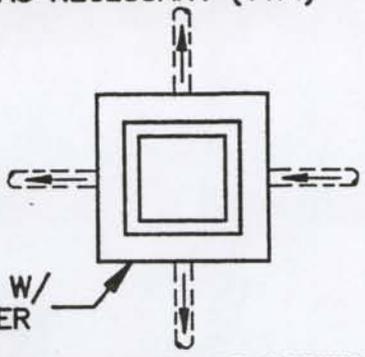

**PLAN**

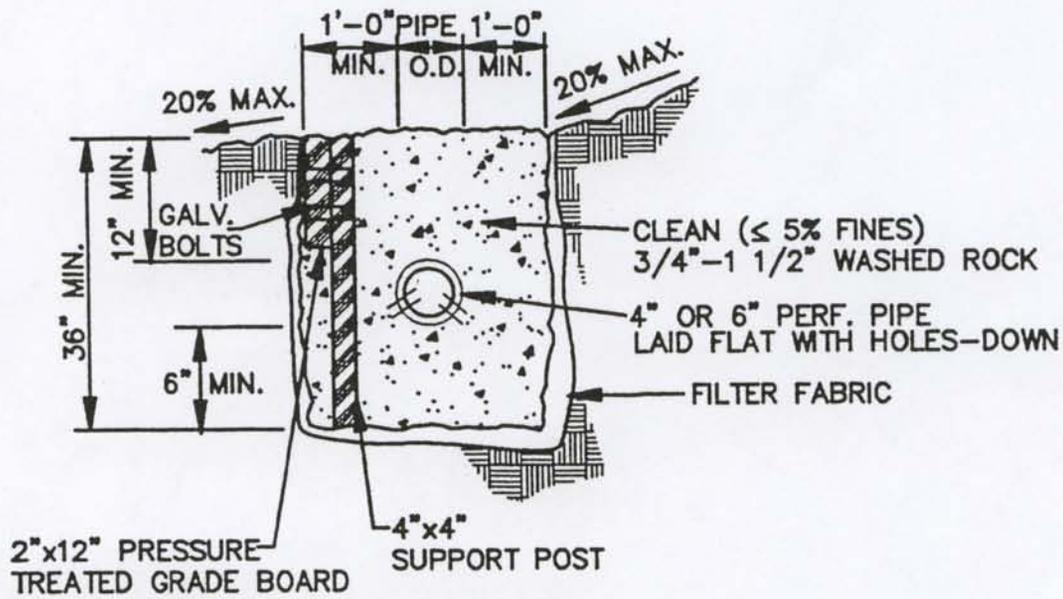

**SECTION A-A**

**FLOW DISPERSION TRENCH**

N.T.S.

**NOTES:**

1. THIS TRENCH SHALL BE CONSTRUCTED SO AS TO PREVENT POINT DISCHARGE AND/OR EROSION.
2. TRENCHES MAY BE PLACED NO CLOSER THAN 50 FEET TO ONE ANOTHER.
3. TRENCH AND GRADE BOARD MUST BE LEVEL. ALIGN TO FOLLOW CONTOURS OF SITE.
4. GRADE BOARD SUPPORT POST SPACING AS REQUIRED BY SOIL CONDITIONS.

TOWN OF FRIDAY HARBOR			
FLOW DISPERSION TRENCH			
APPROVED: <i>C. King</i> TOWN ADMINISTRATOR			DWG. NO. 5-1
DATE: 1/16/97		DRWN: L.T.	CHKD: T.N.
DATE: 1/16/97			SCALE: NO SCALE