
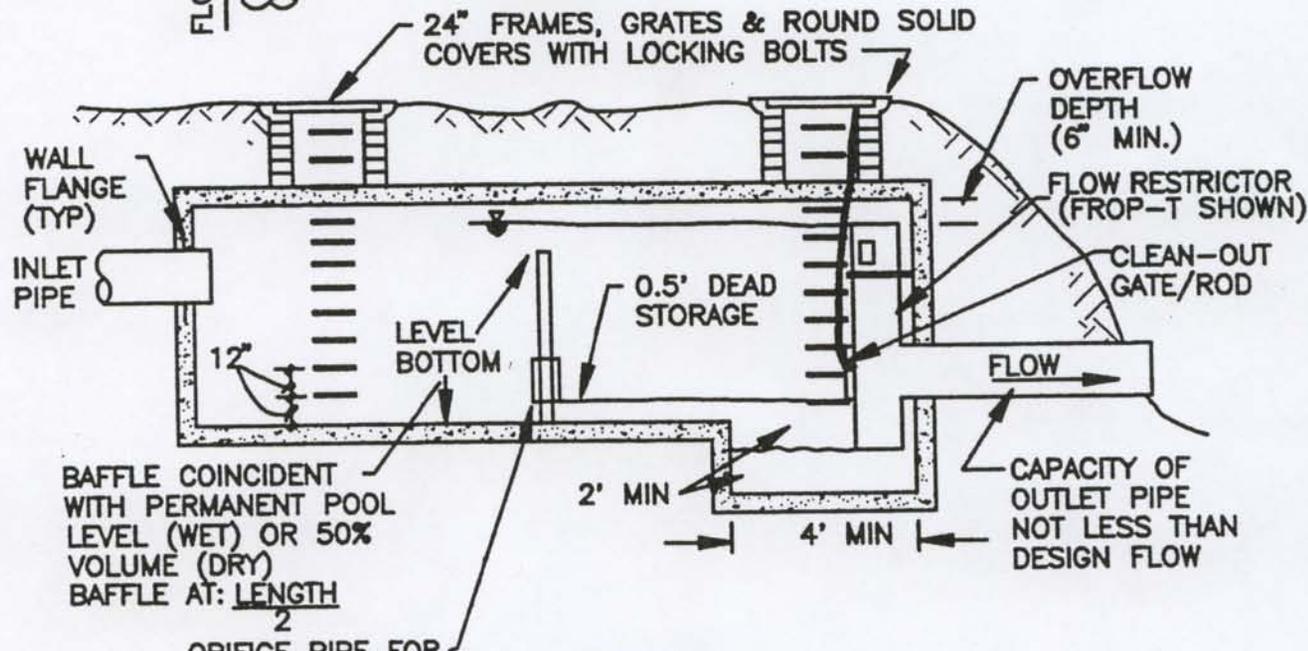


SECOND MH REQUIRED ONLY IF LENGTH OF DETENTION CHAMBER IS > 50' OR ONE PER CELL FOR MULTI-CELLLED VAULTS. PROVIDE PARTITIONS AS REQUIRED WITH ADEQUATE FLOW-THROUGH AT BOTTOM (LEAVING 0.5' DEAD STORAGE) & AIR VENT AT TOP.

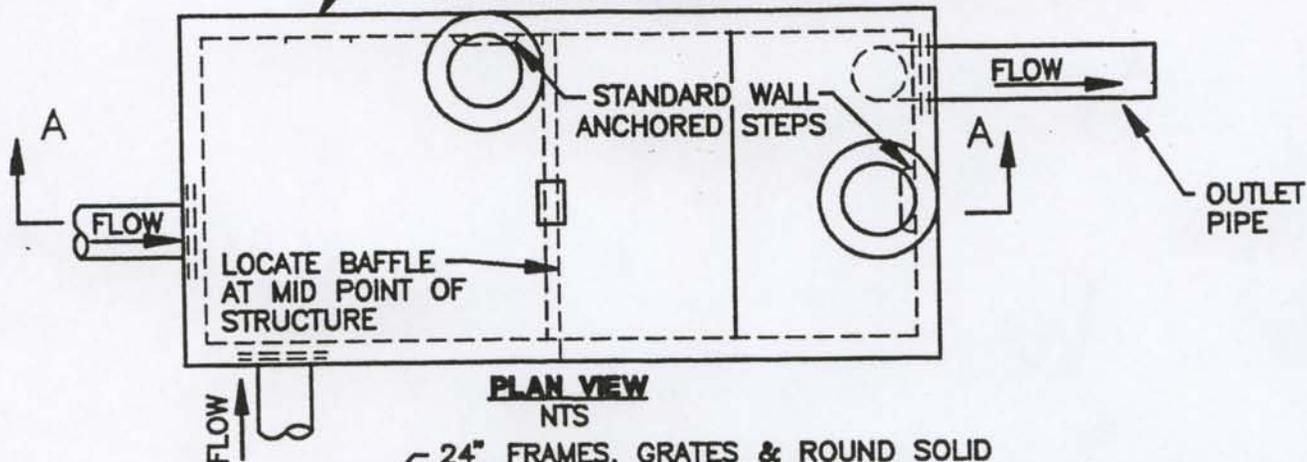

**SECTION A-A**

- NOTES:
1. PLANS MUST BE DESIGNED & STAMPED BY A REGISTERED PROFESSIONAL STRUCTURAL ENGINEER.
  2. ALL METAL PARTS SHALL BE CORROSION RESISTANT. STEEL PARTS GALVANIZED AND ASPHALT COATED (TREATMENT I OR BETTER).
  3. PROVIDE WATER STOP AT ALL CAST-IN-PLACE CONSTRUCTION JOINTS. PRECAST VAULTS SHALL HAVE APPROVED RUBBER GASKET SYSTEM.

**TYPICAL DETENTION VAULT (DRY/WET)**  
N.T.S.

<b>TOWN OF FRIDAY HARBOR</b>			
<b>TYPICAL DETENTION VAULT (DRY/WET)</b>			
APPROVED:		DWG. NO.	
<i>C. King</i> TOWN ADMINISTRATOR		1/16/97 DATE	
DATE:	DRWN:	CHKD:	SCALE:
1/16/97	L.T.	T.N.	NO SCALE